

FILTER ELEMENT – P

Pre-Filter (Particulate)

DESCRIPTION

P grade filter elements have been specifically developed for efficient removal of coarse solid particles and bulk liquids from compressed air⁽¹⁾. This type of filter is generally used as pre-filter for coalescing filter.

APPLICATIONS⁽²⁾

- Automotive
- Electronics
- Food & Beverage
- Chemical
- Petrochemical
- Plastics
- Paint
- General industrial application

⁽¹⁾For any other technical gas please contact us or your local dealer.

⁽²⁾P grade filter element can be used in variety of applications. For applications not listed please contact us or your local dealer.



FILTER ELEMENT RATING ACCORDING TO ISO8573-1

Solid particles	Water	Oil
Class 6	-	-


Validated according to ISO 12500-3

TECHNICAL SPECIFICATION

Operating temperature	1,5 - 65 °C	35 - 149 °F
Operating pressure	0 - 16 bar (g)	0 - 232 psi
Differential pressure (dry)	10 mbar	0,145 psi
Differential pressure (wet)	20 mbar	0,290 PSI
Particle retention (nominal) ⁽⁴⁾	99,99% (3 µm)	
Particle retention rate ISO ⁽³⁾	95 %	
Flow direction	INSIDE to OUT	

⁽³⁾Tested according to ISO12500-3, 1bar(a), nominal flow, 06050 P, MPPS-(5/1m)

⁽⁴⁾After initial layer of dust is generated on surface of filter media

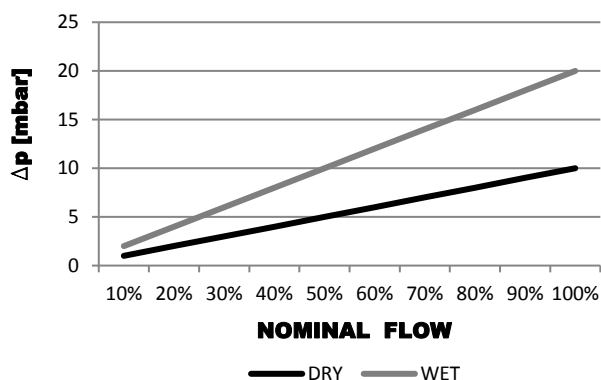

MATERIALS

Filter media	Acrylic fibers, cellulose
Support media	Polyester
Support (inner-outer)	Stainless steel 1.4301
Bonding	Polyurethane
Endcaps	PA6 with 30% glass fibers
Sealing	NBR

SIZES

FILTER ELEMENT SIZE	DIMENSIONS [mm]	FLOW CAPACITY [Nm ³ /h]	FLOW CAPACITY [scfm]	FITS INTO FILTER HOUSING
03528 P	Ø=28;h=35	10	6	AAF 0006
05528 P	Ø=28;h=55	18	11	AAF 0016
03844 P	Ø=44;h=38	30	18	AAF 0026 / 0036
06050 P	Ø=51;h=60	60	35	AAF 0046 / AF & AAF 0056
07050 P	Ø=51;h=70	78	46	AF & AAF 0076
14050 P	Ø=51;h=140	120	70	AF & AAF 0106
12075 P	Ø=75;h=125	198	116	AF & AAF 0186
22075 P	Ø=75;h=225	335	197	AF & AAF 0306
32075 P	Ø=75;h=325	510	300	AF & AAF 0476
50075 P	Ø=75;h=505	780	459	AF & AAF 0706
51090 P	Ø=90;h=510	1000	588	AF 0946
76090 P	Ø=90;h=760	1500	882	AF 1506
76090 P	Ø=90;h=760	1680	990	AF 1756
51140 P	Ø=140;h=510	2160	1270	AF 2006
75140 P	Ø=140;h=750	2760	1620	AF 2406

ø=Diameter;h=Height

CORRECTION FACTORS

To calculate the correct capacity of a given filter based on actual operating conditions, multiply the nominal flow capacity by the appropriate correction factor(s).

CORRECTED CAPACITY = NOMINAL FLOW CAPACITY x C_{OP} x C_{OT}


OPERATING PRESSURE

[bar]	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16
[psi]	29	44	58	72	87	100	115	130	145	160	174	189	203	218	232
C _{OP}	0,38	0,5	0,63	0,75	0,88	1	1,13	1,25	1,38	1,50	1,63	1,75	1,88	2,00	2,13

MAINTENANCE

Replace filter element at least once per year or when pressure drop reaches 350mbar.

INFORMATION IN THIS DOCUMENT IS SUBJECT TO CHANGE WITHOUT NOTICE

	<p>Our quality management system is certified by BUREAU VERITAS in conformity with ISO 9001:2008 Reg. number: 200285</p>	
---	--	--